


TYPE LACN COLDROOM CONTROLLER

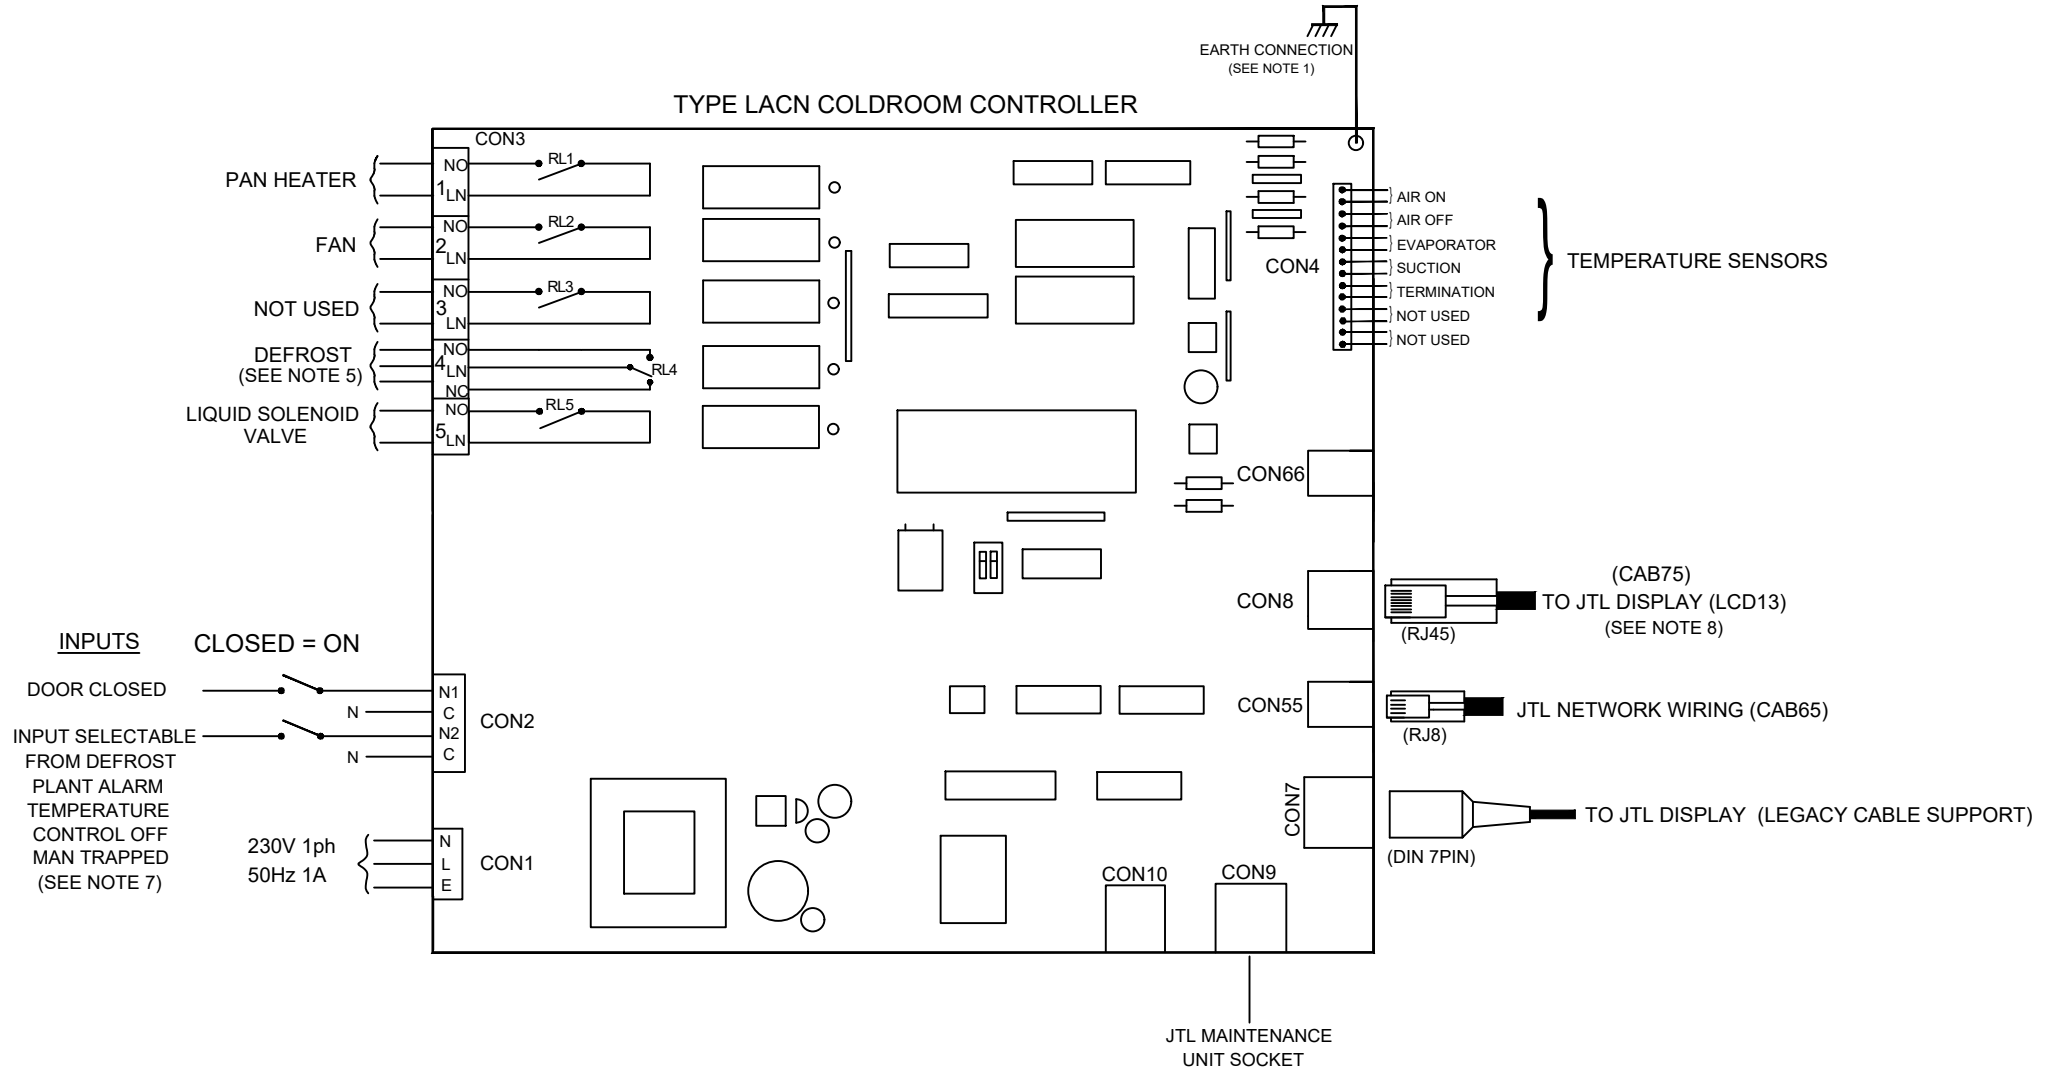

NOTES:

1. THE LACN CONTROLLER MUST BE EARTHED TO THE CHASSIS VIA THE CONTROLLER FIXING HOLE AS SHOWN.
2. TO MEET EMC REQUIREMENTS THE CONTROLLER MUST BE INSTALLED ACCORDING TO THE INSTALLATION REQUIREMENTS SHEET FOR THIS PRODUCT.
3. INPUTS REQUIRE 'C' CONNECTED TO NEUTRAL AND THE INPUT TO 230Vac WHEN SIGNAL IS PRESENT.
4. PLANT INPUTS TO CON2 MUST BE ON THE SAME PHASE AS THE SUPPLY ON CON1.

5. THE DEFROST OUTPUT HAS CHANGEOVER CONTACTS. SELECT THE APPROPRIATE OUTPUT FOR THE APPLICATION.
6. TO ENSURE THAT INTERNALLY FITTED SUPPRESSORS WORK CORRECTLY:- ENSURE THAT THE LINE VOLTAGE IS CONNECTED TO TERMINALS 'LN' AND EACH LOAD IS CONNECTED TO TERMINALS MARKED 'NO' OR 'NC.'
7. USE ITEM 138 TO SELECT INPUT FUNCTION.
8. LCD13 SUPPORTED FROM VERSION 0.00.5 FIRMWARE.

THIS UNIT IS NOT RATED FOR 415V

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP

		JTL SYSTEMS LTD	
		41 KINGFISHER COURT, HAMBRIDGE RD, NEWBURY BERKSHIRE: RG14 5SJ TEL: 01635 263646 FAX: 01635 263647	
ISS	DESCRIPTION	APP'D	DATE
3	CAB75 CONNECTION & NOTE 8 ADDED	MJK	11/08
2	UNPUT TEXT & NOTE 7 CHANGED	MJK	09/04
4	SUCTION VALVE NOT USED	MJK	11/18
TITLE: COLDROOM CONTROLLER CONNECTIONS			
TYPE: LACN			
PROJ.	DRG No:	SHT	OF
LA	03099	1	1
			ISS.
			4