


ZM05 CONNECTIONS

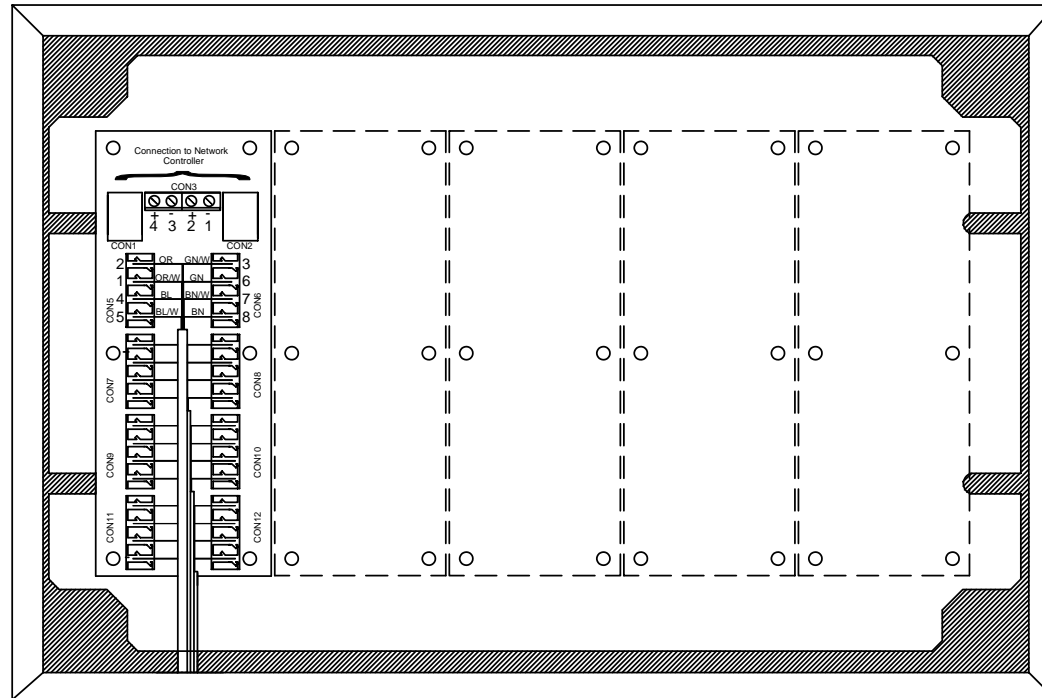

Up to 8 CAT5 cables can be terminated per PCB


↓

To shop floor

IMPORTANT NOTES:

1. Colour Scheme/pin numbering is according to TIA568B
2. Cable must be to CAT5 UTP spec or above.
3. Correct tool must be used for IDC connectors.
4. PCBs and mounting plate must be removed prior to drilling the box.

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP

 JTL SYSTEMS LTD 41 KINGFISHER COURT, HAMBRIDGE RD, NEWBURY, BERKSHIRE: RG14 5SJ TEL: 01635 263646 FAX: 01635 263647			
ISSUE	DESCRIPTION	APP'D	DATE
1	ORIGINAL ISSUE	MJK	10/04
TITLE: 5 ZONE CAT5 ZONE MARSHALING CONNECTIONS			
PROJ.	DRG No:	SHT OF	ISS.
	03117	1 1	1