


CRITICAL ALARM OUTPUTS*

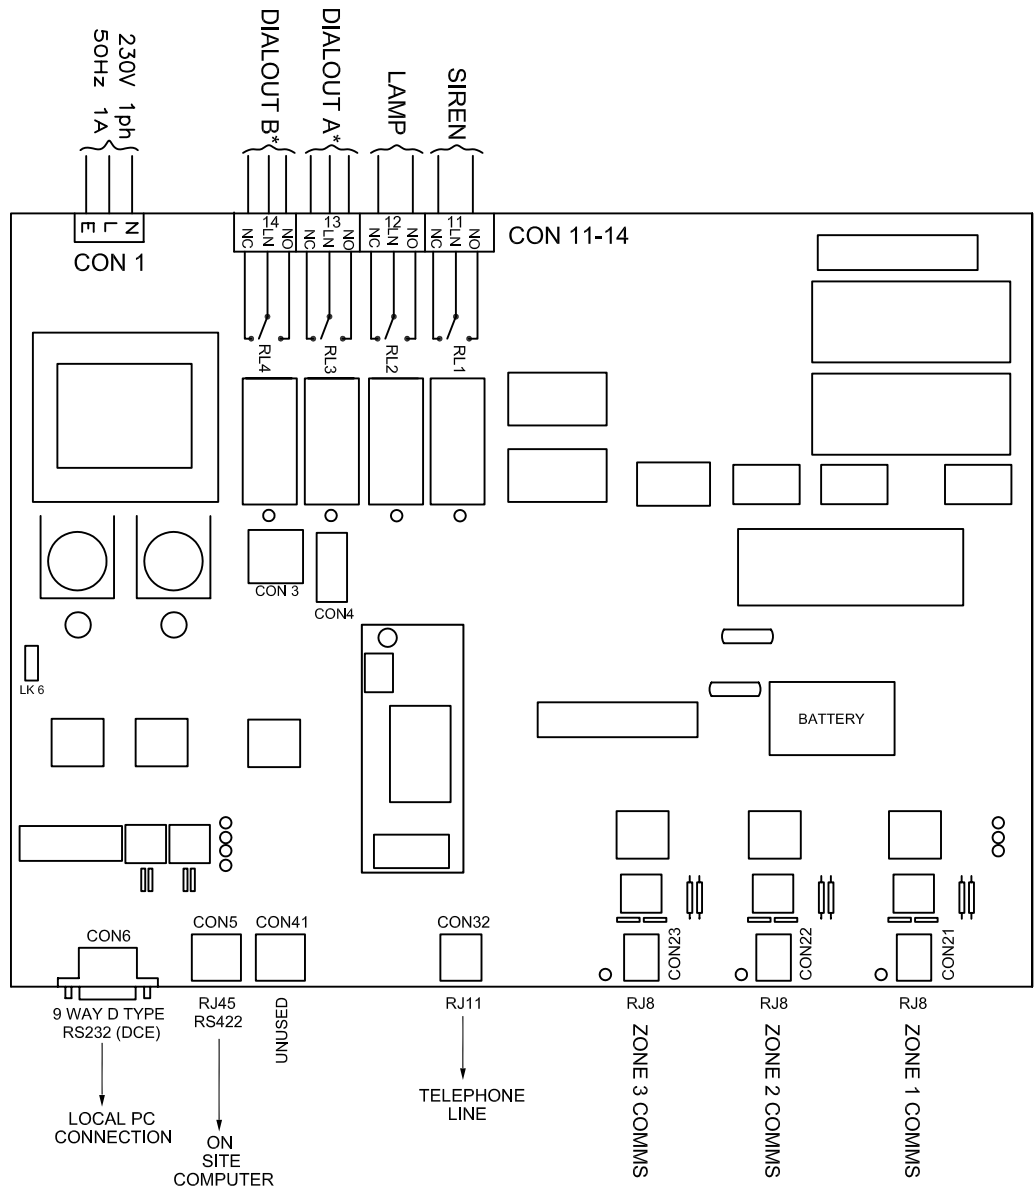

*DIALOUT

- A - CONTINUOUS OUTPUT PRESENT FOR DURATION OF UNACCEPTED ALARM.
- B - PULSED OUTPUT FOR NEW UNACCEPTED ALARM PULSE DURATION 2 MINUTES ON A 15 MINUTE CYCLE.

DIALOUT RELAYS DE ENERGISE FOR ALARM CONDITION.

SIREN ON FOR UNACCEPTED ALARM CAN BE MUTED FROM DISPLAY PUSHBUTTONS OR ASSOCIATED COMPUTER DEPENDING ON SETUP

LAMP ON FOR ANY UNACCEPTED ALARM.

		JTL SYSTEMS LTD 41 KINGFISHER COURT, HAMBRIDGE RD, NEWBURY, BERKSHIRE. RG14 5SJ TEL: 01635 263646 FAX: 01635 263647	
ISS	DESCRIPTION	APP'D	DATE
1	ORIGINAL ISSUE	MJK	05/06
TITLE: NC300 RANGE NETWORK CONTROLLER WIRING			
TYPE: NC300 PCB			
PROJ.	DRG No:	SHT	OF
NC300	03298	1	1