


HP240 CO₂ DISCHARGE CONTROL



NOTE

- To ensure that internally fitted suppressors work correctly, connect line voltages to terminals prefixed LN and the corresponding loads to terminals prefixed LD. Ensure neutral is connected to terminal marked N. Terminal 1 must have control supply neutral connected to it.
- Note output 1 is unsuppressed.

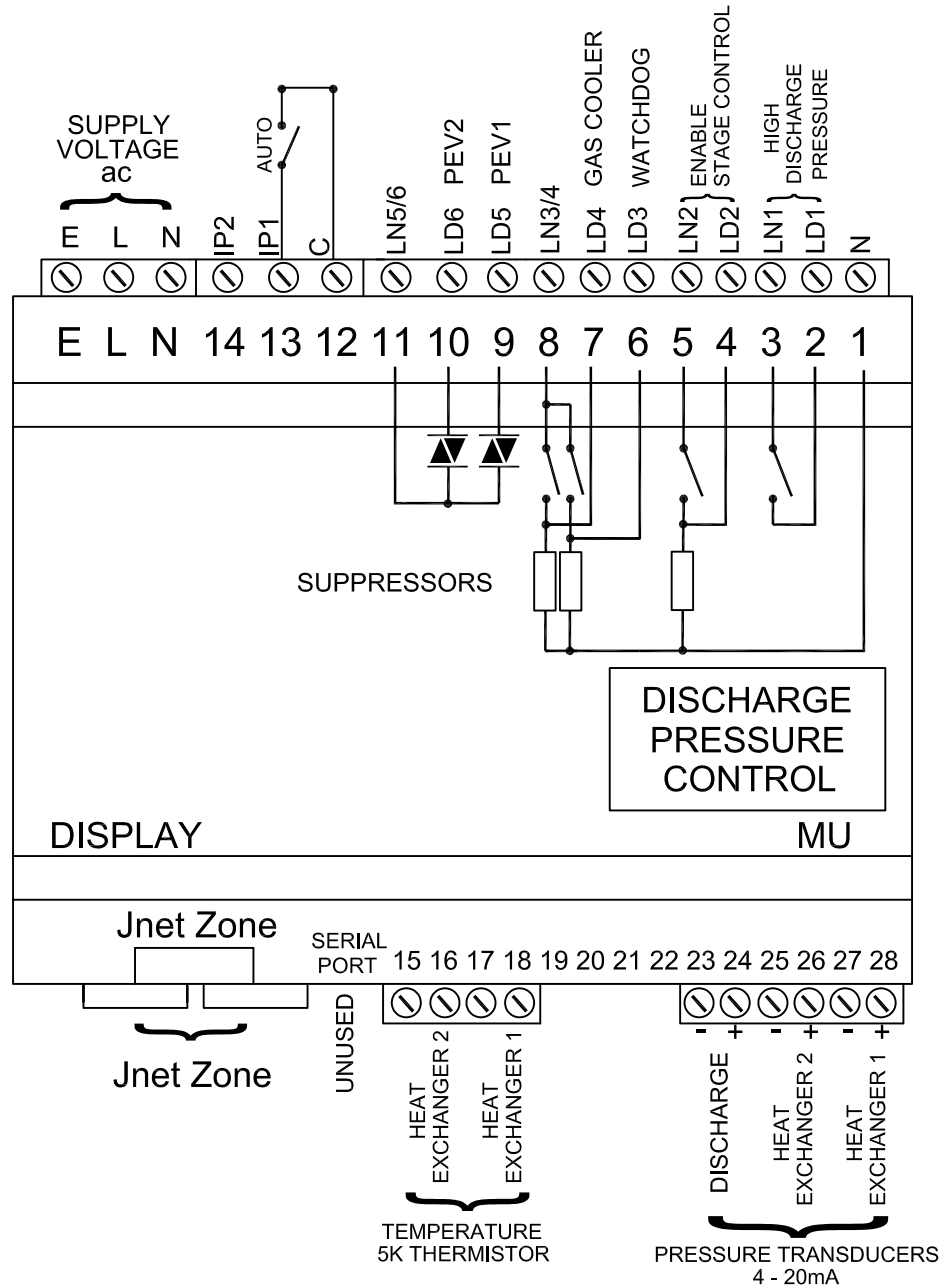

JTL SYSTEMS LTD
 41 KINGFISHER COURT, HAMBRIDGE RD,
 NEWBURY, BERKSHIRE: RG14 5SJ
 TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APPD	DATE
1	ORIGINAL ISSUE	MJK	11/11

TITLE:
HP240 CO₂ DISCHARGE CONTROL

PROJ.	DRG No:	SHT	OF	ISS.
	03903	1	1	1