


UACI COLDROOM CONTROLLER & ASSOCIATED
PARTS SCHEMATIC

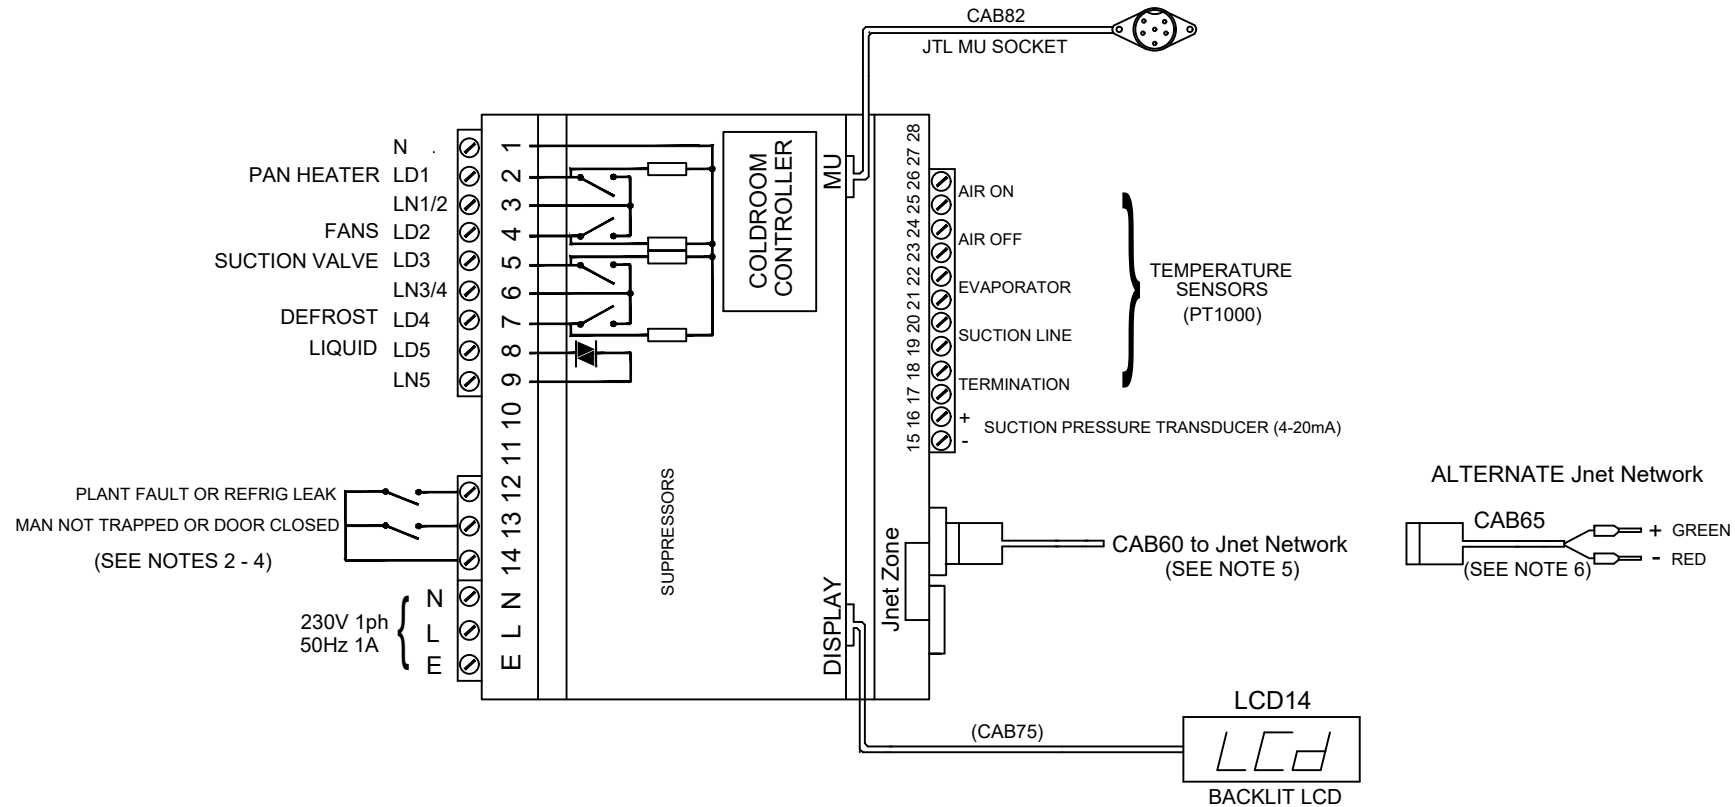

NOTES:

1. TO MEET EMC REQUIREMENTS THE CONTROLLER MUST BE INSTALLED ACCORDING TO THE INSTALLATION REQUIREMENTS SHEET FOR THIS PRODUCT.
2. INPUTS ARE FOR VOLT FREE CONTACTS. CONTACTS ARE CLOSED FOR THE 'ON' CONDITION SHOWN.
3. CHOICE OF REFRIGERATION LEAK ADDED FROM V0.00.2
4. CHOICE OF DOOR OPEN ADDED FROM V0.00.4
5. USE CAB60 CABLE TO CONNECT DIRECTLY TO OTHER UNITS ON THE JTL Jnet NETWORKS OR AN APPROPRIATE JTL NETWORK JUNCTION BOX PROVIDING A CAT5 CABLE TERMINATION.
6. USE CAB65 CABLE TO SCREW TERMINALS WHERE Jnet NETWORK IS IMPLEMENTED IN 2 CORE CABLES.

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP

 JTL SYSTEMS LTD. 41 KINGFISHER COURT, HAMBRIDGE RD, NEWBURY, BERKSHIRE. RG14 5SJ TEL: 01635-263646 FAX: 01635-263647			
ISS	DESCRIPTION	APP'D	DATE
3	ADDED NOTES 5 & 6. UPDATED CABLES	MJK	10/19
2	INPUTS UPDATED, NOTES 2 & 3 ADDED	MJK	03/13
1	ORIGINAL ISSUE	MJK	09/11
TITLE: COLDROOM CONTROLLER & ASSOCIATED PARTS SCHEMATIC			
TYPE: UACI			
PROJ. UA	DRG No: 03882	SHT 1	OF 1
		ISS. 3	