
## UACA COLDROOM CONTROLLER & ASSCOCIATED PARTS SCHEMATIC

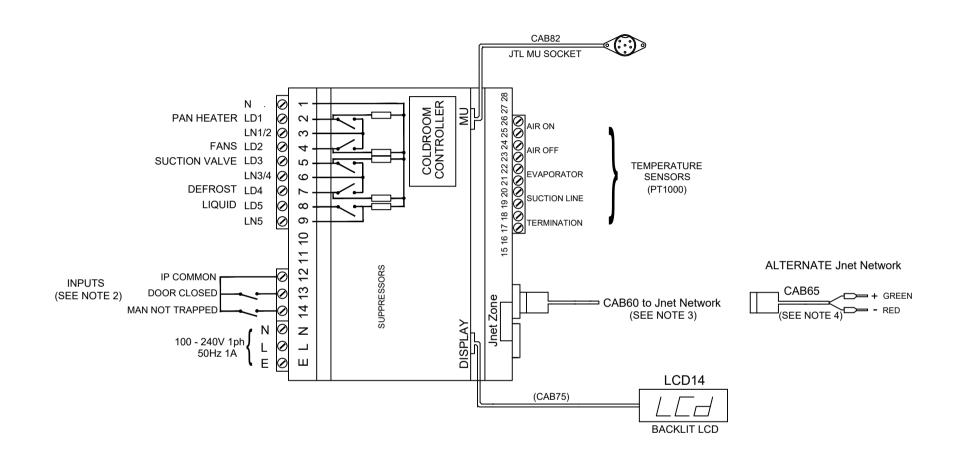

## NOTES;

- 1. TO MEET EMC REQUIREMENTS THE CONTROLLER MUST BE INSTALLED ACCORDING TO THE INSTALLATION REQUIREMENTS SHEET FOR THIS PRODUCT.
- 2. INPUTS ARE FOR VOLT FREE CONTACTS.
  CONTACTS ARE CLOSED FOR THE 'ON' CONDITION SHOWN.
- 3. USE CAB60 CABLE TO CONNECT DIRECTLY TO OTHER UNITS ON THE JTL Jnet NETWORKS OR AN APPROPRIATE JTL NETWORK JUNCTION BOX PROVIDING A CAT5 CABLE TERMINATION.
- 4. USE CAB65 CABLE TO SCREW TERMINALS WHERE Jnet NETWORK IS IMPLEMENTED IN 2 CORE CABLES.

JTL SYSTEMS LTD.
41 KINGFISHER COURT, HAMBRIDGE RD, NEWBURY, BERKSHIRE. RG14 5SJ
TEL: 01635-263646 FAX: 01635-263647

ISS DESCRIPTION APP'D DATE

2 ADDED NOTE 4 & CAB65 CABLE MJK 10/19
1 ORIGINAL ISSUE MJK 01/17

TITLE: COLDROOM CONTROLLER & ASSCOCIATED PARTS SCHEMATIC

TYPE: UACA

PROJ. DRG No: O4762 SHT OF ISS.
UA 04762 SHT OF ISS.

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP